


Programmable control for automatic bleeding of dirt and sludge.



MP-2

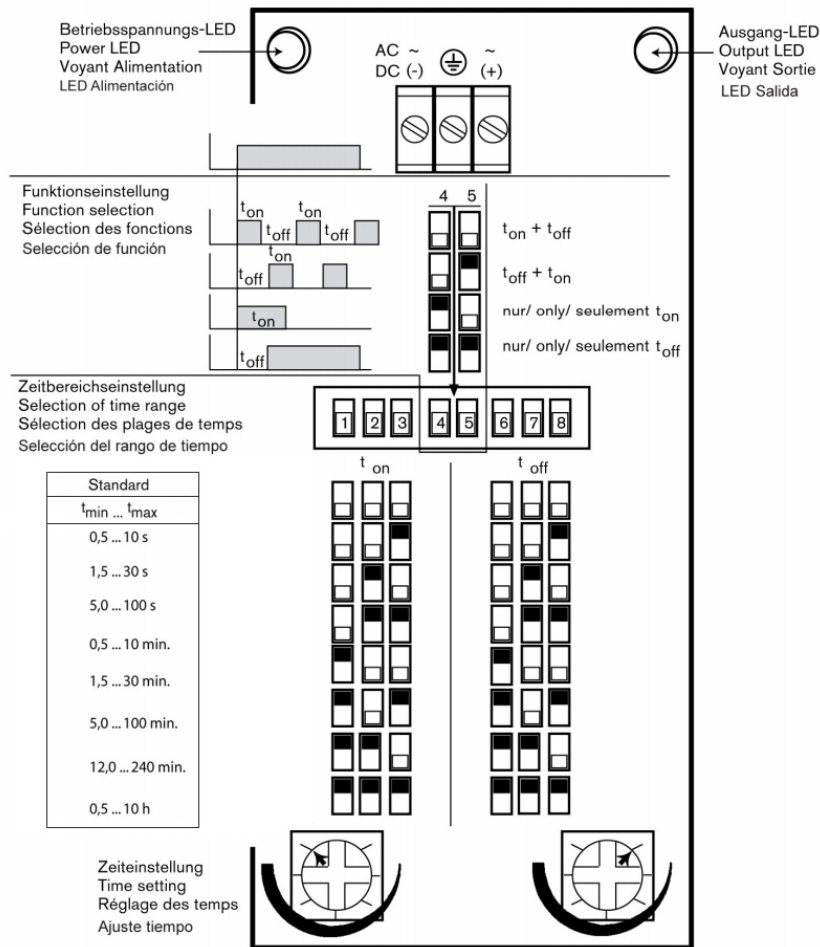

The setting of time is proportional:

Example: Setting 8 sec in the time range 0,5...10 sec. becomes 8 h when changing the range to 0,5...10 h.

Rotation of the connection board

ATTENTION: Ensure voltage supply is disconnect!

Ease terminal block out with a screws driver point and lift carefully. Connection board can be rotated 2x90° in each direction from standard position.

NOTE: Do not twist wires off, Insert connection board into body until it snaps in.

